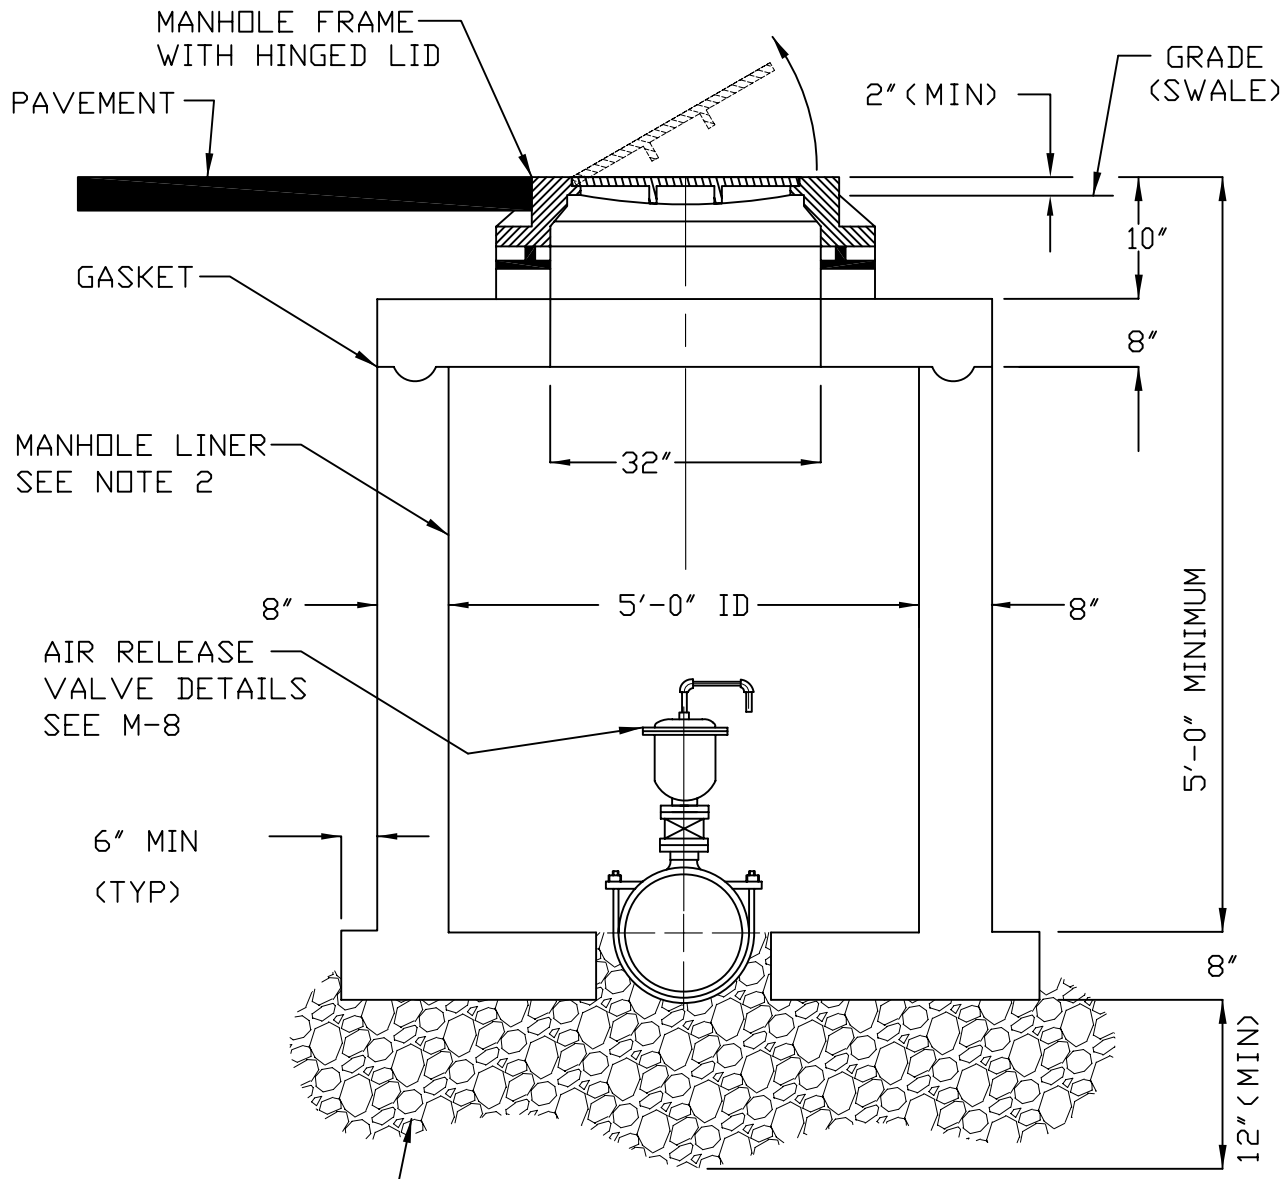

ELEVATION

WATER MAIN/WASTEWATER MAIN

NOTES

1. AIR RELEASE VALVE IS TO BE LOCATED INSIDE A CONCRETE MANHOLE WITH HINGED LID. ALL MATERIALS PER IRCDUS APPROVED MANUFACTURERS' PRODUCT LIST.
2. MANHOLES FOR SEWER FORCE MAINS SHALL BE LINED. ALL LINING MATERIAL SHALL BE PER INDIAN RIVER COUNTY APPROVED MANUFACTURES' PRODUCT LIST.
3. SEE AIR RLEASE VALVE DETAIL (M-8)
4. SEE TRACER WIRE DETAIL. (M-14)

INDIAN RIVER COUNTY DEPARTMENT OF UTILITIES SERVICES	INDIAN RIVER COUNTY * FLORIDA *	AIR RELEASE VALVE MANHOLE (AUTOMATIC - WATER/WASTEWATER) SEPTEMBER 2011	DRAWING NO. M-7