


PLAN VIEW

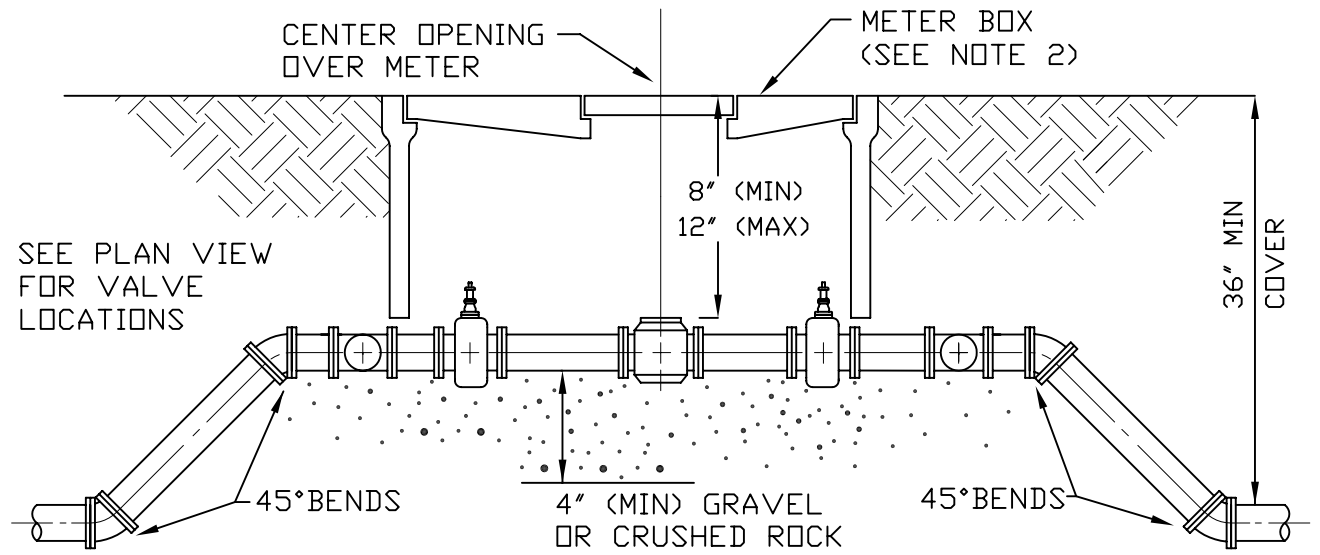


BY PASS NOT SHOWN FOR CLARITY

ELEVATION

NOTES

1. METERS MUST BE INSTALLED BY CONTRACTOR PER MANUFACTURERS' RECOMENDATIONS.
2. MINIMUM SIZE AND TYPE OF METER BOXES SHALL BE DETERMINED DURING DESIGN AND APPROVED BY IRCDUS.
3. BYPASS ADAPTER TEE SHALL BE A MINIMUM DISTANCE OF 5 TIMES THE PIPE DIAMETER DOWNSTREAM OF METER.
4. PIPING THRU VALVE BOX TO BE APPROVED FLANGE JOINT MATERIALS AND RESTRAINED PER IRCDUS.
5. ALL METERS SHALL BE PER IRCDUS APPROVED MANUFACTURERS' PRODUCT LIST.

INDIAN RIVER COUNTY DEPARTMENT OF UTILITIES SERVICES		<h2 style="margin: 0;">PERMANENT SEWER FORCEMAIN METER DETAIL</h2> <p style="text-align: right; font-size: small;">JULY 2007</p>	DRAWING NO. <span style="font-size: 2em; font-weight: bold;">S-17</span>
--	---	--	--