


PLAN VIEW

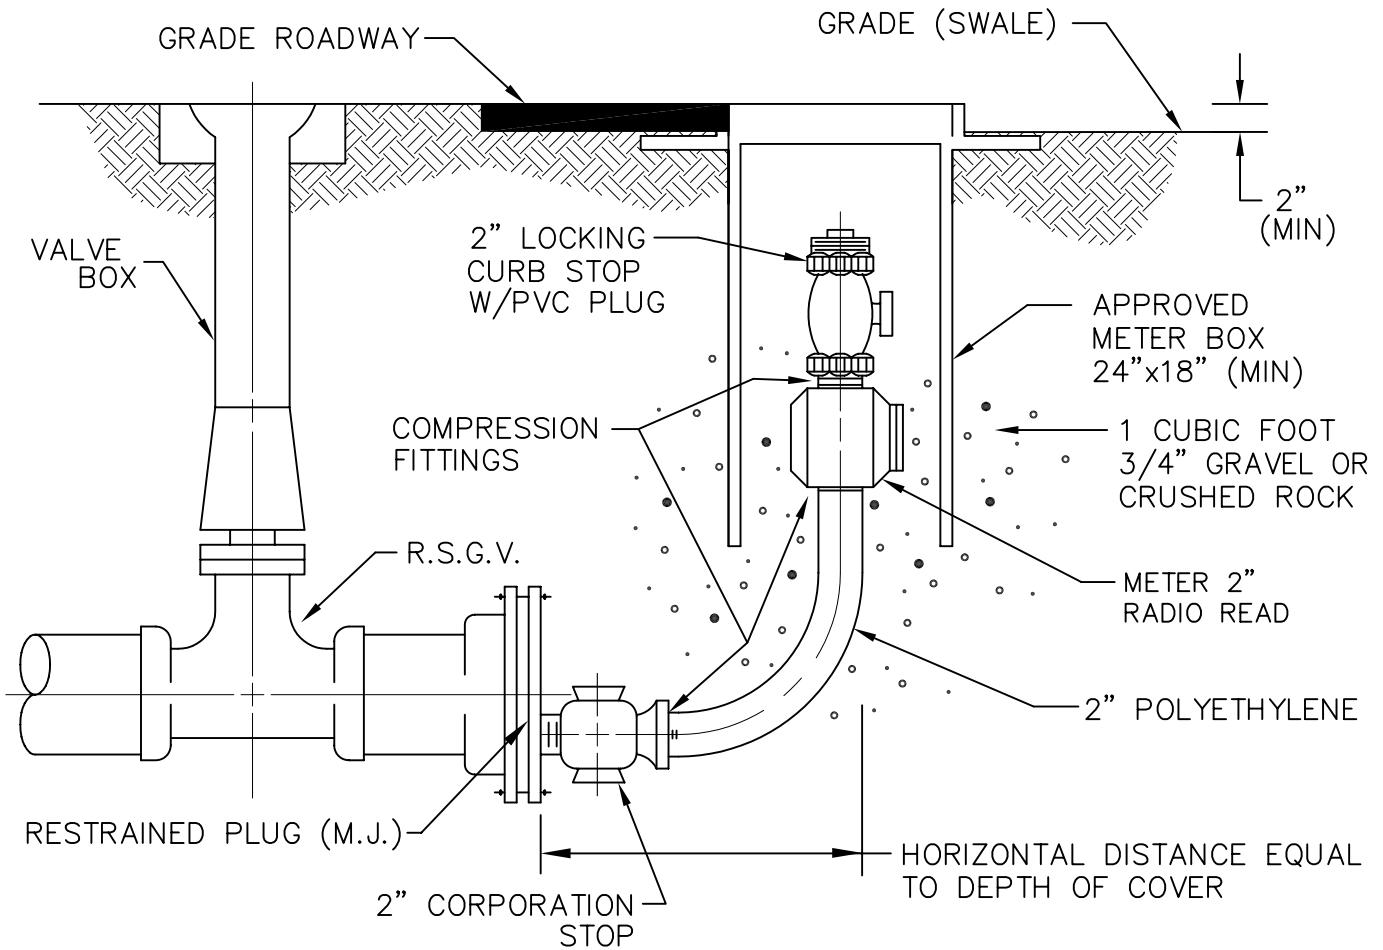

ELEVATION

NOTES

1. BLOW-OFF TO BE LOCATED AT ALL DEAD END LINES, AS REQUIRED BY IRCDUS.
2. ALL MATERIALS ARE TO BE PER IRCDUS APPROVED MANUFACTURERS' PRODUCT LIST.
3. METHODS OF RESTRAINT AS APPROVED BY IRCDUS.
4. TRACE WIRE TO BE INSTALLED AS PER DETAIL M-14.
5. LOCATE MARKER BALLS ARE TO BE LOCATED ADJACENT TO ALL VALVE BOXES AND PLACED IN ALL METER BOXES WITHIN 24" FROM SURFACE.

INDIAN RIVER COUNTY  
DEPARTMENT OF  
UTILITIES SERVICES



AUTOMATIC  
2" BLOW-OFF

DRAWING  
NO.

W-3

JULY 2009