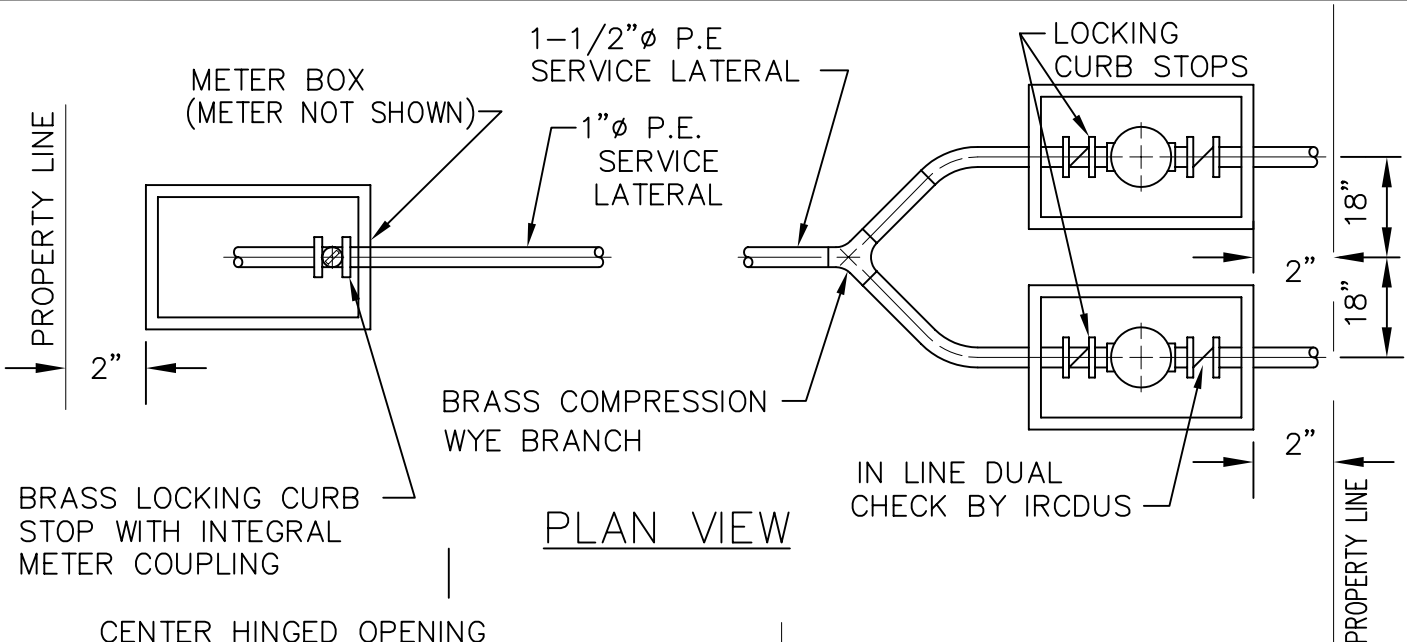

PLAN VIEW

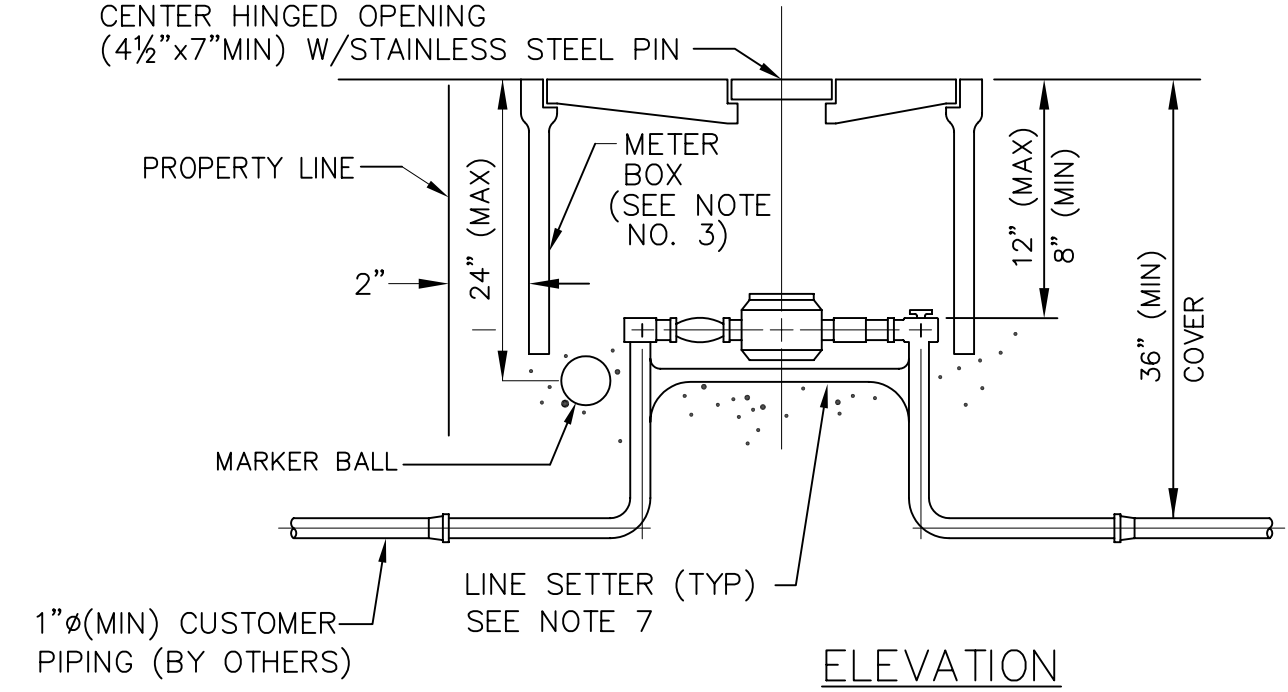

ELEVATION

NOTES

1. METERS OVER 2"ø MUST BE APPROVED BY IRCDUS AND INSTALLED BY CONTRACTOR.
2. ALL METERS 2"ø AND SMALLER WILL BE SUPPLIED AND INSTALLED BY IRCDUS.
3. MINIMUM SIZE OF METER BOXES: 1"ø SERVICE (12" X 18"); 1–1/2"ø AND 2"ø SERVICE (17" X 28").
4. METERS GREATER THAN 2"ø SHALL BE COMPOUND METERS. REFER TO IRCDUS APPROVED MANUFACTURERS PRODUCT LIST.
5. TRACE WIRE TO BE INSTALLED AS PER DETAIL M–14.
6. LOCATE MARKER BALLS ARE TO BE LOCATED ADJACENT TO ALL INLINE VALVE BOXES AND PLACED IN ALL METER BOXES WITHIN 24" FROM SURFACE.
7. LINE SETTER PER IRCDUS APPROVED MANUFACTURES' PRODUCT LIST.

INDIAN RIVER COUNTY DEPARTMENT OF UTILITIES SERVICES	INDIAN RIVER COUNTY * FLORIDA *	METER BOX JULY 2009	DRAWING NO. W–5