


PLAN VIEW

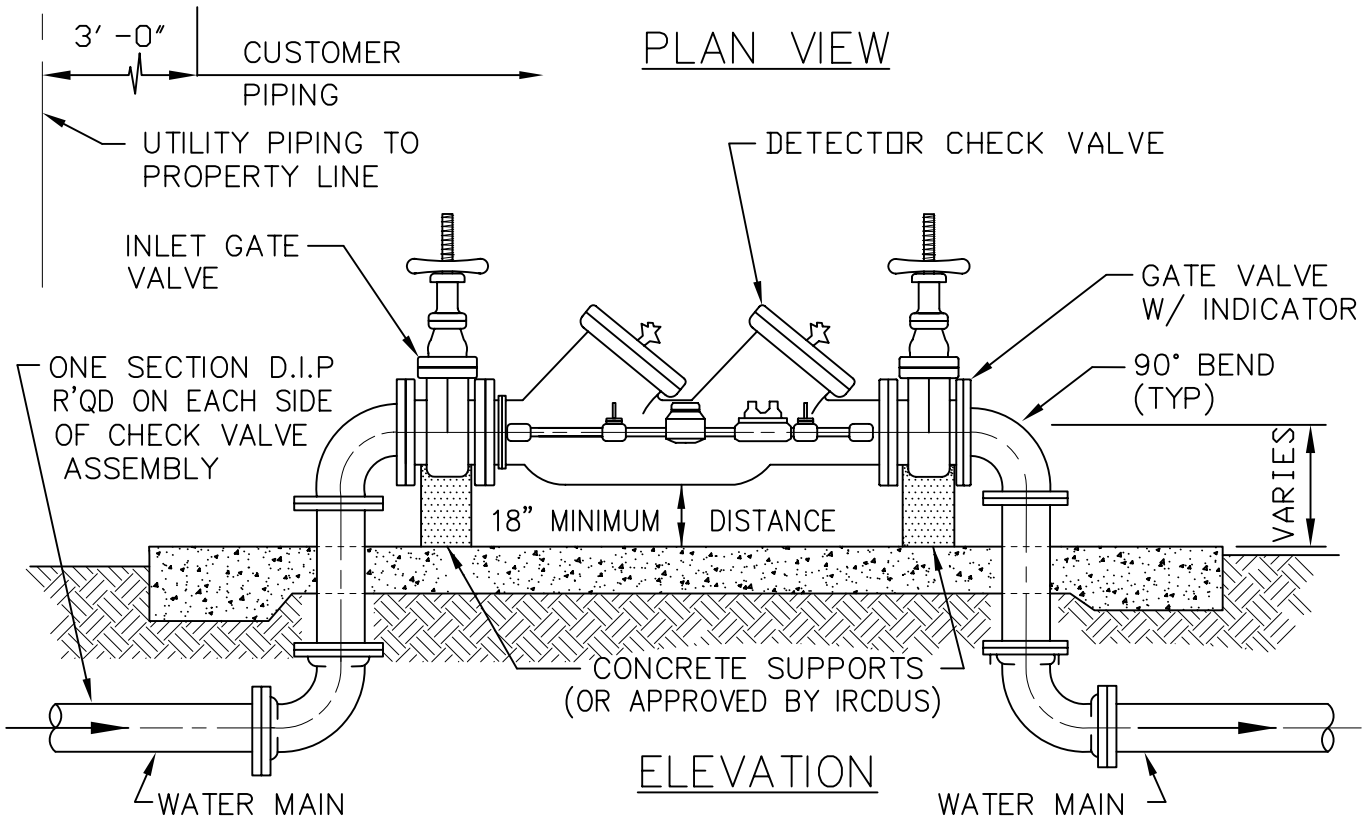

NOTES

1. ALL BUILDINGS WITH SPRINKLERS MUST HAVE AN IRCDUS APPROVED DETECTOR CHECK VALVE AND METER TO BE INSTALLED ON THEIR OWN PROPERTY. DETECTOR CHECKS SHALL BE INSTALLED IN ACCORDANCE WITH THE STATE FIRE MARSHALL CODE AND IRCDUS STANDARD. CHECK VALVE AND METER SHALL BE MOUNTED ABOVE GROUND.
2. DETAIL SHOWN CAN BE MODIFIED AND APPROVED BY IRCDUS FOR EACH INDIVIDUAL PROJECT.
3. ALL MATERIALS ARE TO BE PER IRCDUS APPROVED MANUFACTURERS' PRODUCT LIST.

INDIAN RIVER COUNTY  
DEPARTMENT OF  
UTILITIES SERVICES



DOUBLE-DETECTOR  
CHECK VALVE  
ASSEMBLY

JULY 2009

DRAWING  
NO.

W-8